


GENERAL NOTES:

- 1. PROVIDE REMOVABLE BLANK INSERT FOR UNUSED PORTS.
- 2. REFER TO SPECIFICATIONS FOR LABELING REQUIREMENTS.
- 3. REFER TO FLOOR PLANS FOR DEVICE QUANTITIES AND LOCATION.
- 4. JACKS SHALL BE CONFIGURED PER ANSI/TIA/EIA T568B REQUIREMENTS.
- 5. REFER TO 1/E-3002-7.2 FOR COPPER RISER DIAGRAM.

SCHEDULE NOTES:


1. PROVIDE STAINLESS STEEL FACEPLATE WITH MATING LUGS FOR WALL HUNG PHONE.

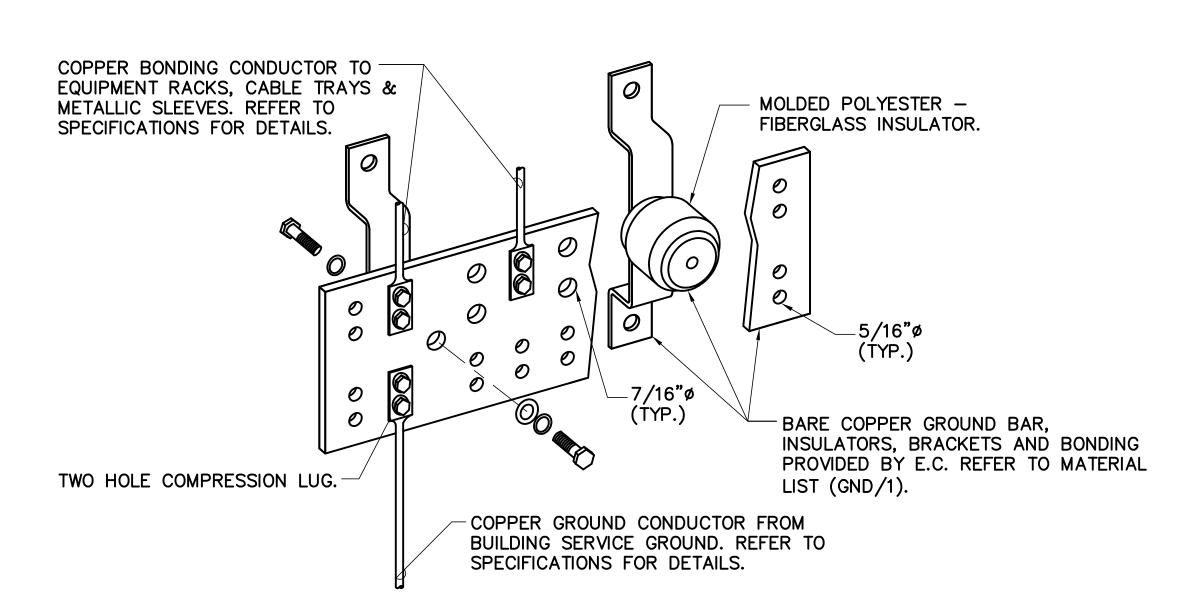

GROUND BAR DETAIL

1. REFER TO MATERIAL LIST (GND/1) FOR WIDTH REQUIREMENTS.

2. REFER TO 3/E-3002-7.2 FOR ROOM GROUNDING DETAIL.

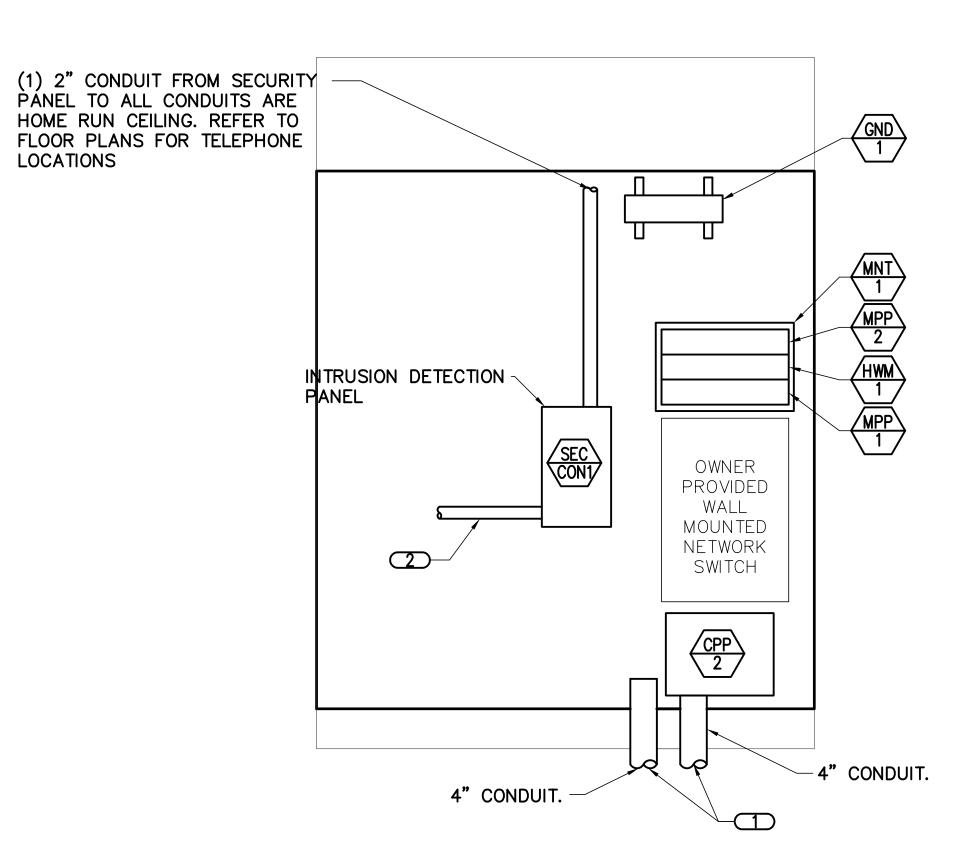


MAINTENANCE REMOTE EQUIPMENT

CABINET

 \bigcirc REFER TO 1/E-3.1 FOR CONTINUATION AND ADDITIONAL INFORMATION.


(1) 1" CONDUIT TO SECURITY CABINET. REFER TO 2/E-3002-7.3 FOR CONTINUATION.

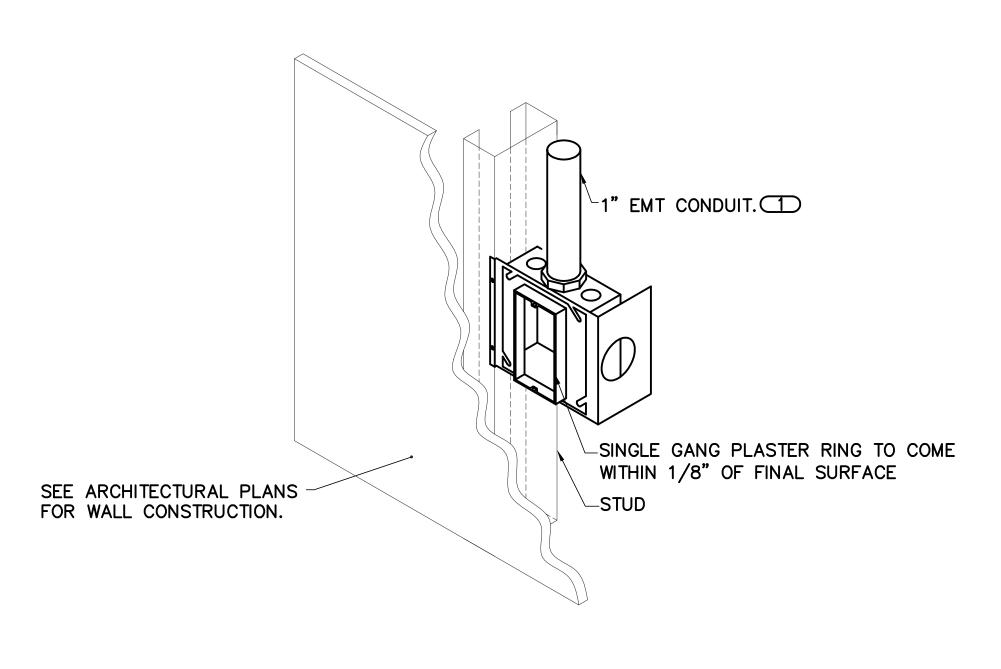

KEY NOTES:

INFORMATION.

ROUTE CONDUIT TO ABOVE ACCESSIBLE CEILING UNLESS OTHERWISE NOTED. REFER TO FLOOR PLANS FOR ADDITIONAL

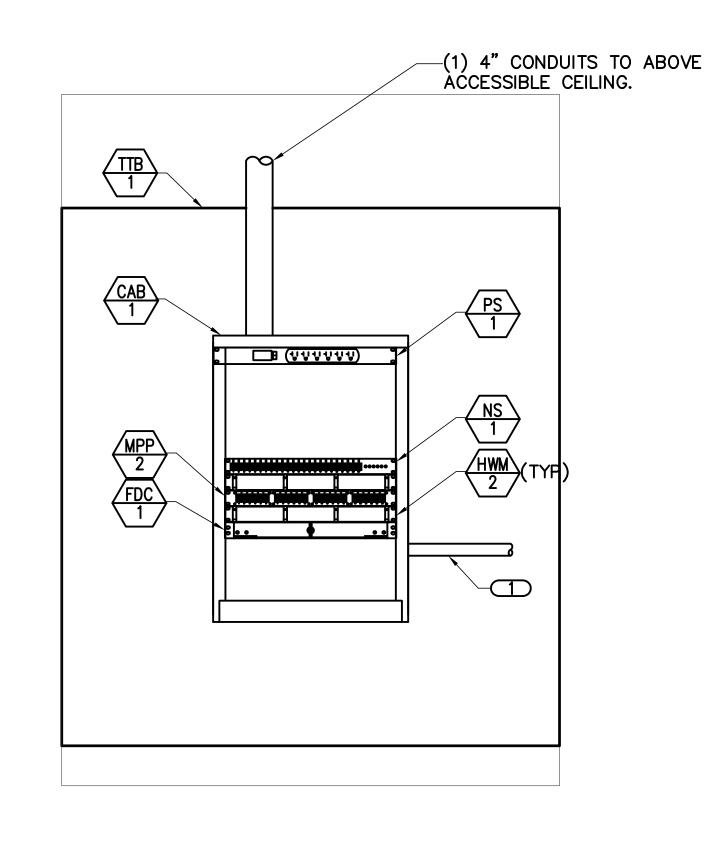


MAINTENANCE REMOTE EQUIPMENT **CABINET (CCTV)**

(1) 1" CONDUIT TO INTRUSION DETECTION PANEL. REFER TO 1/E-3002-7.3 FOR CONTINUATION.


TECHNOLOGY ROUGH-IN MOUNTING DETAIL NO SCALE

BID DOCUMENTS 7/1/2011

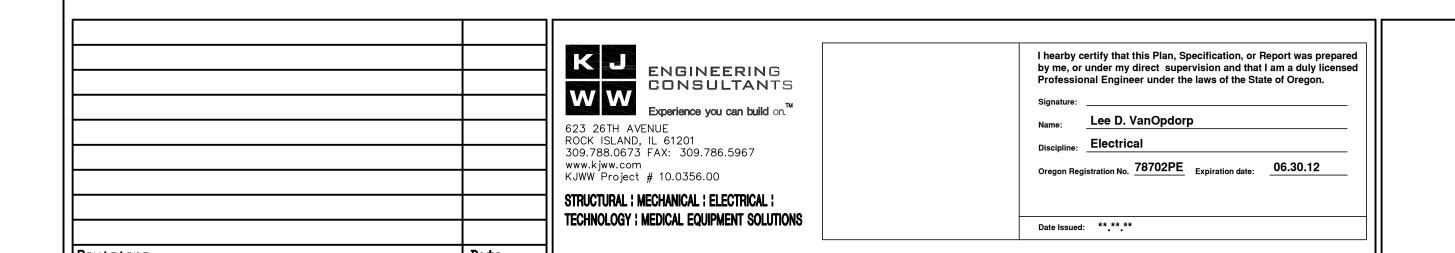

Anderson Engineering of Minnesota, LLC

13605 1st AVENUE NORTH, SUITE 100, PLYMOUTH, MN 55441 TEL (763) 412-4000 FAX (763) 412-4090 www.ae-mn.com

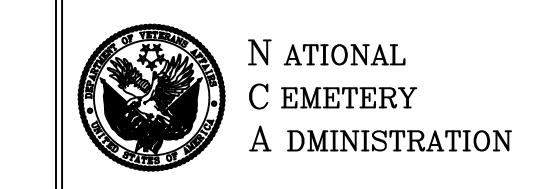

Drawing Title

TECHNOLOGY RISERS AND DETAILS	REPLACE ADMINISTRATION AND			7-1-2011
	MAINTENANCE BUILDING AND SITE IMPROVEMENTS		Project No. 906CM3009	
Approved: Director, Office of Construction Management	Building Number 3002	Checked PETMCG	Drawn JAYSTI	DRAWING NO.
Approved: Director, Project Management Service	Location EAGLE POINT NATIONAL CEMETERY 2763 RILEY ROAD EAGLE POINT, OR 97524			E-3002-7 Dwg. 143 Of